



Received:03/13/2015	Completed:03/27/2015	Letter: I	CT	P.O.#:	Test Report #:	3-06896-0-
Client's Identification	Style: Atlantic Screen fv. 66011-2m. Date of Mfg: 2015.03.06. Composition: 100% Polyester. Weight: 390 g/lm. End Use: Upholstery Fabric.					
Tested For: Bente Ellingsoe, Quality Department				Key Test: ASTM E 84/ACT		1185
Gabriel A/S Hjulgagervej 55 DK-9000 Aalborg, Denmark				Tel: 011-45-9630-3100 Fax: 011-45-9811-6125		Ext:

ASTM E84: LE 2009c; R 11/09; V 11/09

PC:ME /dl

TEST PERFORMED: As cited by the ACT Voluntary Performance Guidelines (August 2014)--

ASTM E 84 - Standard Test Method for Surface Burning Characteristics of Building Materials *

APPROXIMATE THICKNESS OF SPECIMEN (as measured by Govmark): 0.038"

PRODUCT CATEGORY:

- Direct Glue Wallcoverings
- Wrapped Panels & Upholstered Walls
- Other Products: _____

* Note: Textile or expanded vinyl wallcoverings classified by this procedure are limited to use in sprinklered areas in certain public occupancies. If textile or expanded vinyl wallcoverings are used in non-sprinklered areas, the NFPA 265 corner fire test is mandated.

For other interior finish products in non-sprinklered areas, a room corner fire test also applies. This would be NFPA 286.

SPECIMEN MOUNTING:

- Self Supporting: The test specimen, the face of which was 23" ± 1" x 24', was such that it remained in position in the tunnel during the fire test, and no additional support was required.
- Adhered to IRC: The test specimen was bonded to three 1/4" IRC (Inorganic Reinforced Cement) boards (a cement asbestos substitute) to form a test specimen the face of which was 23" ± 1" x 24'.
- Adhered to Gypsum: The test specimen was adhered to 5/8" thick Type X gypsum board, to form a test specimen the face of which was 23" ± 1" x 24'.
- Unadhered: The 23" ± 1" x 24' specimen was not adhered to any substrate. Instead, it was laid over a 2" hexagonal wire mesh screen and 1/4" rods.
- Other: _____

Received:03/13/2015	Completed:03/27/2015	Letter: I	CT	P.O.#:	Test Report #:	3-06896-0-
---------------------	----------------------	-----------	----	--------	----------------	------------

Client's Identification	Style: Atlantic Screen fv. 66011-2m. Date of Mfg: 2015.03.06. Composition: 100% Polyester. Weight: 390 g/lm. End Use: Upholstery Fabric.
-------------------------	------------------------------------------------------------------------------------------------------------------------------------------

Tested For: Bente Ellingsoe, Quality Department Gabriel A/S Hjulmagervej 55 DK-9000 Aalborg, Denmark	Key Test: ASTM E 84/ACT Tel: 011-45-9630-3100 Fax: 011-45-9811-6125	1185 Ext:
----------------------------------------------------------------------------------------------------------------------	-------------------------------------------------------------------------------	------------------

RESULTS:

Flame Spread Index: 5
 Smoke Developed: 25

ACCEPTANCE CRITERIA:

	Flame Spread Index	Smoke Developed
	-----	-----
Class A	0 - 25	450 or less

NOTE: Class A is also known as Class 1, and may be so specified in some Codes.

CONCLUSION: Based on the above Results and Acceptance Criteria the item tested:

Complies Does not comply


REMARKS: None

DATA SUMMARY:

Time to Ignition: 00.15 minutes
 Maximum Flame Spread "Distance": 01.11 feet
 Maximum Flame Spread "Time": 00.72 minutes

CERTIFICATION: I certify that the above results were obtained after testing specimens in accordance with the procedures and equipment specified by ASTM E 84.

 AUTHORIZED SIGNATURE
 GOVMARK
 CT/pm

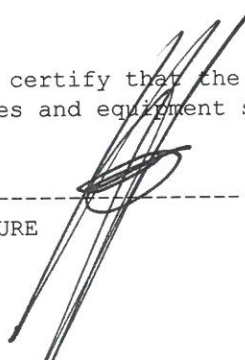

Robert I. Brown

MAR 31 2015

(Page 2 of 2)